



Wireless Monitoring System *by TempSys*

# How To Configure DST Settings for CheckPoint

Document No. D1519

Revised: March 12, 2011


Revision D

## Overview


Daylight Savings Time (“DST”) ends and begins in the fall and spring, respectively. In order to properly configure the application server and the CheckPoint application for geographic locations where DST is observed (Arizona and Hawaii do not observe DST), please follow the steps below.

## Configuration Instructions


**Step #1** – From the rich client on the CheckPoint application server, select Status → Services and click on **Temperature Service**. Click on the Stop button to stop the Temperature Service.

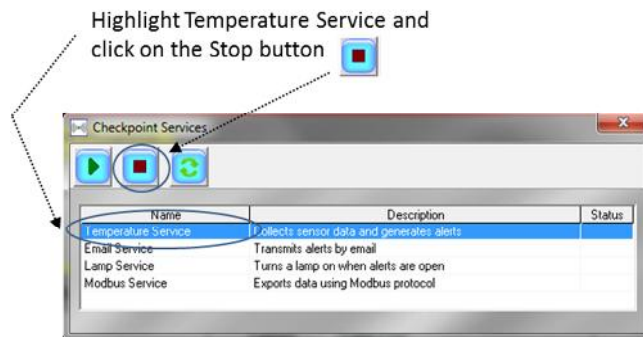

**Step #2** – On the application server, go to Control Panel and select **Date and Time**.




**Step #3** – Click the button to **Change time zone ...**

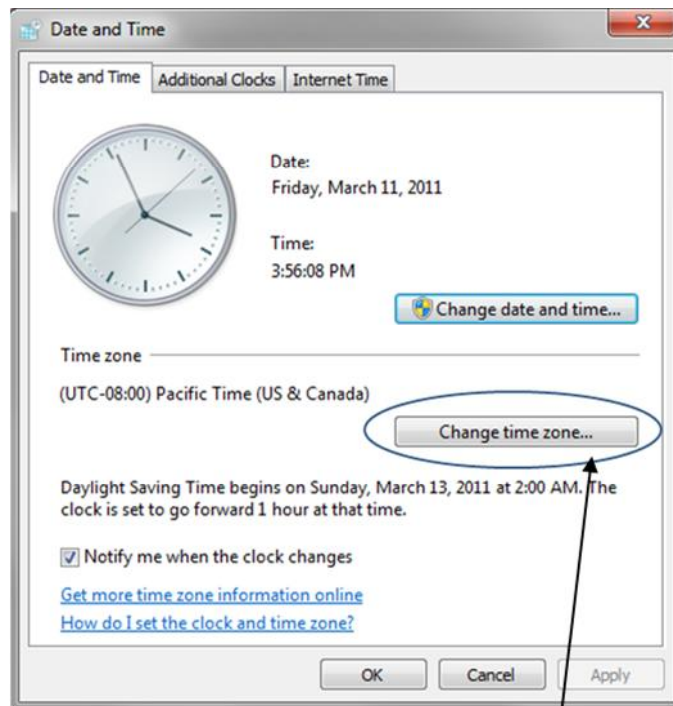


Select "Change time zone ..."

**Step #4** –CHECK or verify the "Automatically adjust clock for Daylight Saving Time" box is already checked.

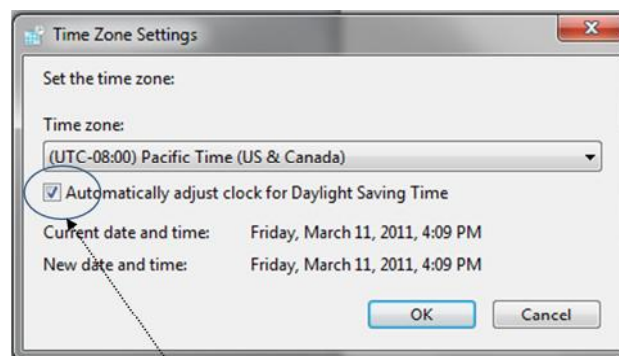

Make sure the Automatically adjust clock for Daylight Saving Time is CHECKED

**Step #5** – Go back to **CheckPoint Services** and click on **Temperature Service** and then click the **Start** button to start Temperature Service.

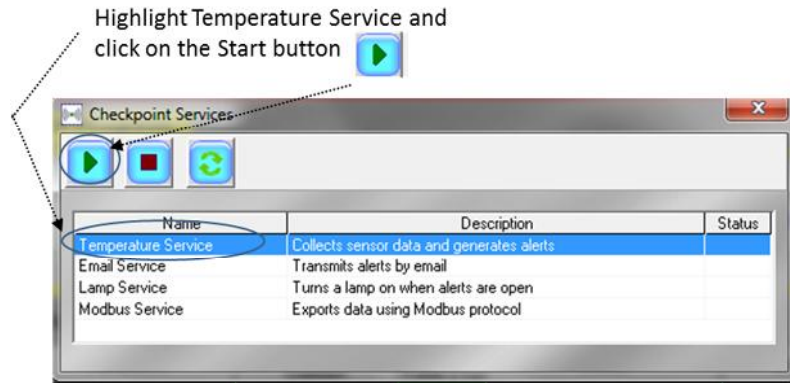

The steps above will properly configure Daylight Saving Time on the application server so that the CheckPoint application will make proper adjustments at the start and end of DST.

### For Further Assistance

If you need further assistance, please contact CheckPoint Customer Support by submitting a service ticket contact at <http://checkpoint.kayako.com> or sending an Email message to [support@tempsys.net](mailto:support@tempsys.net) with a short description of the issue in the subject line, your contact information, and a detailed description of the issue you are experiencing.